

Series TY-FRB — 2.8, 4.2, 5.6, and 8.0 K-Factor Upright, Pendent, and Recessed Pendent Sprinklers Quick Response, Standard Coverage

General Description

The TYCO Series TY-FRB, 2.8, 4.2, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers described in this data sheet are quick response, standard coverage, decorative 3 mm glass bulb-type spray sprinklers designed for use in light or ordinary hazard, commercial occupancies such as banks, hotels, and shopping malls.

The recessed version of the Series TY-FRB Pendent Sprinkler, where applicable, is intended for use in areas with a finished ceiling. This recessed pendent sprinkler uses one of the following:

- A two-piece Style 10 (1/2 inch NPT) or Style 40 (3/4 inch NPT) Recessed Escutcheon with 1/2 inch (12,7 mm) of recessed adjustment or up to 3/4 inch (19,1 mm) of total adjustment from the flush pendent position, or a
- A two-piece Style 20 (1/2 inch NPT) or Style 30 (3/4 inch NPT) Recessed Escutcheon with 1/4 inch (6,4 mm) of recessed adjustment or up to 1/2 inch (12,7 mm) of total adjustment from the flush pendent position.

The adjustment provided by the Recessed Escutcheon reduces the accuracy to which the fixed pipe drops to the sprinklers must be cut.

Corrosion-resistant coatings, where applicable, are utilized to extend the life of copper alloy sprinklers beyond that which would otherwise be obtained when exposed to corrosive atmo-

IMPORTANT

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

spheres. Although corrosion-resistant coated sprinklers have passed the standard corrosion tests of the applicable approval agencies, the testing is not representative of all possible corrosive atmospheres. Consequently, it is recommended that the end user be consulted with respect to the suitability of these coatings for any given corrosive environment. The effects of ambient temperature, concentration of chemicals, and gas/chemical velocity, should be considered, as a minimum, along with the corrosive nature of the chemical to which the sprinklers will be exposed.

An intermediate level of the Series TY-FRB Pendent Sprinklers is detailed in Technical Data Sheet TFP356, and Sprinkler Guards are detailed in Technical Data Sheet TFP780.

NOTICE

The Series TY-FRB, 2.8, 4.2, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers described herein must be installed and maintained in compliance with this document and with the applicable standards of the National Fire Protection Association, in addition to the standards of any authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. The installing contractor or sprinkler manufacturer should be contacted with any questions.








Sprinkler Identification Number (SIN)


TY1131:	Upright	2.8K, 1/2" NPT
TY1231:	Pendent	2.8K, 1/2" NPT
TY2131:	Upright	4.2K, 1/2" NPT
TY2231:	Pendent	4.2K, 1/2" NPT
TY3131:	Upright	5.6K, 1/2" NPT
TY3231:	Pendent	5.6K, 1/2" NPT
TY4131:	Upright	8.0K, 3/4" NPT
TY4231:	Pendent	8.0K, 3/4" NPT
TY4831:	Upright	8.0K, 1/2" NPT
TY4931:	Pendent	8.0K, 1/2" NPT


TFP171 Page 2 of 10

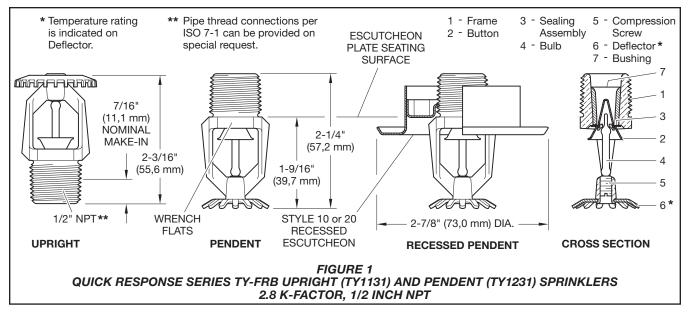

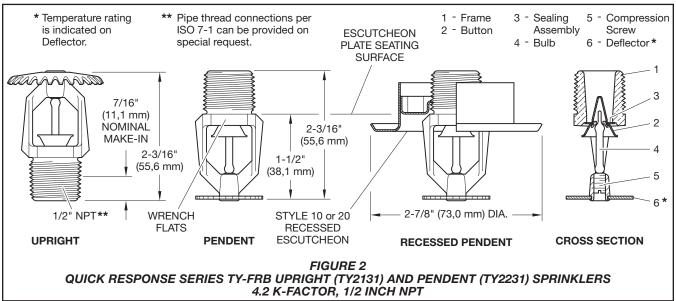

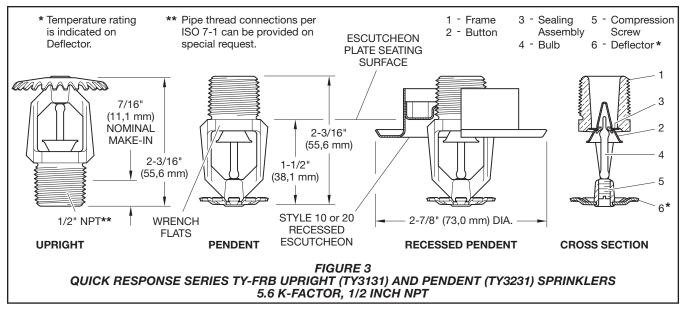

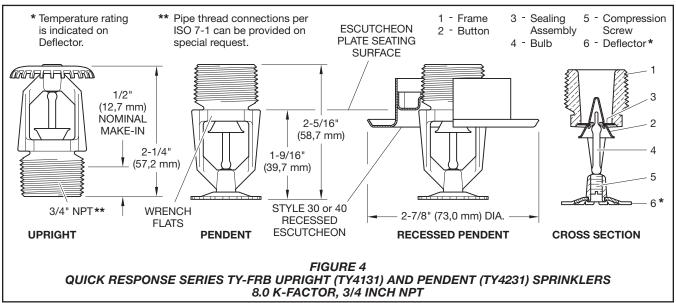

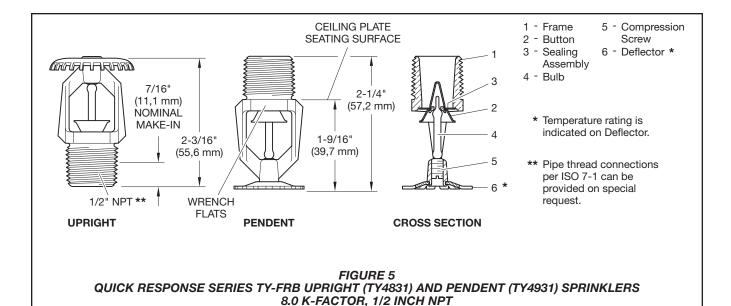

Technical Data

Approvals

UL and C-UL Listed FM, LPCB, and NYC Approved Refer to Table A and B for complete approval information including corrosion-resistant status.

Maximum Working Pressure Refer to Table C.

Discharge Coefficient

K=2.8 GPM/psi^{1/2} (40,3 LPM/bar^{1/2}) K=4.2 GPM/psi^{1/2} (60,5 LPM/bar^{1/2}) K=5.6 GPM/psi^{1/2} (80,6 LPM/bar^{1/2}) K=8.0 GPM/psi^{1/2} (115,2 LPM/bar^{1/2})

Temperature RatingRefer to Table A and B.

Finishes

Sprinkler: Refer to Table D. Recessed Escutcheon: White Coated, Chrome Plated, or Brass Plated.

Physical Characteristics

Frame Bronze
ButtonBrass/Copper
Sealing AssemblyBeryllium
Nickel w/TEFLON
Bulb
Compression Screw Bronze
DeflectorCopper/Bronze
Bushing (K=2.8) Bronze

Operation

The glass bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, allowing the sprinkler to activate and water to flow.

Design Criteria

The TYCO Series TY-FRB, 2.8, 4.2, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklers are intended for fire protection systems designed in accordance with the standard installation rules recognized by the applicable Listing or Approval agency (such as, UL Listing is based on the requirements of NFPA 13, and FM Approval is based on the requirements of FM's Loss Prevention Data Sheets). Only the Style 10, 20, 30, or 40 Recessed Escutcheon, as applicable, is to be used for recessed pendent installations.

Installation

The TYCO Series TY-FRB, 2.8, 4.2, 5.6, and 8.0 K-factor, Upright, Pendent, and Recessed Pendent Sprinklersmust be installed in accordance with this section

General Instructions

Do not install any bulb-type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 inch (1,6 mm) for the 135°F (57°C) and 3/32 inch (2,4 mm) for the 286°F (141°C) temperature ratings.

A leak-tight 1/2 inch NPT sprinkler joint shold be obtained by applying a minimum to maximum torque of 7 to 14 ft.-lbs. (9,5 to 19,0 Nm). A leak tight 3/4 inch NPT sprinkler joint should be obtained with a torque of 10 to 20 ft.-lbs. (13,4 to 26,8 Nm). Higher levels of

torque can distort the sprinkler Inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in the Escutcheon Plate by under- or over-tightening the sprinkler. Re-adjust the position of the sprinkler fitting to suit.

Series TY-FRB Upright and Pendent Sprinklers

The Series TY-FRB Pendent and Upright Sprinklers must be installed in accordance with the following instructions.

Step 1. Install Pendent sprinklers in the pendent position. Install upright sprinklers in the upright position.

Step 2. With pipe-thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step 3. Tighten the sprinkler into the sprinkler fitting using only the W-Type 6 Sprinkler Wrench (Figure 14). With reference to Figures 1 through 5, apply the W-Type 6 Sprinkler Wrench to the sprinkler wrench flats.

Series TY-FRB Recessed Pendent Sprinklers

The Series TY-FRB Recessed Pendent Sprinklers must be installed in accordance with the following instructions.

Step A. After installing the Style 10, 20, 30, or 40 Mounting Plate, as applicable, over the sprinkler threads and with pipe-thread sealant applied to the pipe threads, hand-tighten the sprinkler into the sprinkler fitting.

Step B. Tighten the sprinkler into the sprinkler fitting using only the W-Type 7 Recessed Sprinkler Wrench (Figure

			SPRINKLER FINISH (See Note 5)					
K FACTOR	TYPE	TEMPERATURE	BULB LIQUID COLOR	NATURAL BRASS	CHROME PLATED	SIGNAL*** WHITE		
		135°F (57°C)	Orange	<u> </u>				
	PENDENT (TY1231)	155°F (68°C)	Red					
	and	175°F (79°C)	Yellow	1, 2, 3, 4				
	UPRIGHT (TY1131)	200°F (93°C)	Green					
		286°F (141°C)	Blue	1				
	D=0=00=D	135°F (57°C)	Orange					
2.8 1/2" NPT	RECESSED PENDENT	155°F (68°C)	Red					
	(TY1231)* Figure 6	175°F (79°C)	Yellow					
	i iguic o	200°F (93°C)	Green		1 0 4			
		135°F (57°C)	Orange	1, 2, 4				
	RECESSED PENDENT (TY1231)** Figure 7	155°F (68°C)	Red					
		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		135°F (57°C)	Orange					
	PENDENT (TY2231)	155°F (68°C)	Red					
	` and ´	175°F (79°C)	Yellow					
	UPRIGHT (TY2131)	200°F (93°C)	Green					
		286°F (141°C)	Blue					
		135°F (57°C)	Orange					
4.2 1/2" NPT	RECESSED PENDENT (TY2231)* Figure 8	155°F (68°C)	Red	1, 2				
.,2		175°F (79°C)	Yellow					
		200°F (93°C)	Green					
		135°F (57°C)	Orange					
	RECESSED PENDENT	155°F (68°C)	Red					
	(TY2231)** Figure 9	175°F (79°C)	Yellow					
	i igui e o	200°F (93°C)	Green					

NOTES:

- Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.
- Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.
 Approved by Factory Mutual Research Corporation (FM) as Quick Response Sprinklers.
- Approved by the City of New York under MEA 354-01-E.
- Where Polyester Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion-Resistant Sprinklers.
- * Installed with Style 10 (1/2" NPT) or Style 40 (3/4" NPT) 3/4" Total Adjustment Recessed Escutcheon, as applicable.
- ** Installed with Style 20 (1/2" NPT) or Style 30 (3/4" NPT) 1/2" Total Adjustment Recessed Escutcheon, as applicable.
- *** Frame and Deflector only. Listings and approvals apply to color (Special Order).

N/A: Not Available

TABLE A LABORATORY LISTINGS AND APPROVALS FOR 2.8 AND 4.2 K-FACTOR SPRINKLERS

- 15). With reference to Figures 1 to 4, apply the W-Type 7 Recessed Sprinkler Wrench to the sprinkler wrench flats.
- Step C. After ceiling installation and finishing, slide on the Style 10, 20, 30, or 40 Closure over the Series TY-FRB Sprinkler and push the Closure over the Mounting Plate until its flange comes in contact with the ceiling.

		SPRINKLER FINISH (See Note 8)					
K FACTOR	TYPE	TEMPERATURE	BULB LIQUID COLOR	NATURAL BRASS	CHROME PLATED	SIGNAL*** WHITE	LEAD COATED
	DENDENT	135°F (57°C)	Orange				
	PENDENT (TY3231)	155°F (68°C)	Red				
	and UPRIGHT (TY3131)	175°F (79°C)	Yellow		1, 2, 3, 4, 5, 6, 7		1, 2, 3, 5
		200°F (93°C)	Green				
	(110101)	286°F (141°C)	Blue				
		135°F (57°C)	Orange				
= 0	RECESSED	155°F (68°C)	Red				
5.6 1/2" NPT	PENDENT (TY3231)*	175°F (79°C)	Yellow		1, 2, 4, 5		N/A
.,	Figure 10	200°F (93°C)	Green				
		286°F (141°C)	Blue				
		135°F (57°C)	Orange				
	RECESSED	155°F (68°C)	Red				
	PENDENT (TY3231)**	175°F (79°C)	Yellow		1, 2, 3, 4, 5		N/A
	Figure 11	200°F (93°C)	Green			ı	
		286°F (141°C)	Blue				
	PENDENT (TY4231) and UPRIGHT (TY4131)	135°F (57°C)	Orange				
		155°F (68°C)	Red	1, 2, 3, 4, 5, 6, 7			
		175°F (79°C)	Yellow			1, 2, 5	
		200°F (93°C)	Green				
		286°F (141°C)	Blue				
		135°F (57°C)	Orange	1, 2, 5			
	RECESSED	155°F (68°C)	Red			N/A	
8.0 3/4" NPT	PENDENT (TY4231)*	175°F (79°C)	Yellow				
0, 1 111 1	Figure 12	200°F (93°C)	Green				
		286°F (141°C)	Blue				
		135°F (57°C)	Orange	1, 2, 3, 5		N/A	
	RECESSED	155°F (68°C)	Red				
	PENDENT (TY4231)**	175°F (79°C)	Yellow				
	Figure 13	200°F (93°C)	Green				
		286°F (141°C)	Blue				
<u> </u>	DENDENT	135°F (57°C)	Orange	1, 2, 4, 5, 6			
0.0	PENDENT (TY4931)	155°F (68°C)	Red				
8.0 1/2" NPT	and	175°F (79°C)	Yellow			1, 2, 5	
., 2 141 1	UPRIGHT (TY4831)	200°F (93°C)	Green				
	(114001)	286°F (141°C)	Blue				

NOTES:

- 1. Listed by Underwriters Laboratories, Inc., (UL) as Quick Response Sprinklers.
- 2. Listed by Underwriters Laboratories, Inc., for use in Canada (C-UL) as Quick Response Sprinklers.
- Approved by Factory Mutual Research Corporation (FM) as Quick Response Sprinklers.
- Approved by the Loss Prevention Certification Board (LPCB Ref. No. 007k/04) as Quick Response Sprinklers. However, LPCB does not rate the thermal sensitivity of recessed sprinklers.
- Approved by the City of New York under MEA 354-01-E.
- VdS Approved (For details, contact Tyco Fire Suppression & Building Products, Enschede, Netherlands, Tel. 31-53-428-4444/Fax 31-53-428-3377.)
- 7. Approved by the Loss Prevention Certification Board (LPCB Ref. No. 094a/06) as Quick Response Sprinklers.
- Where Polyester Coated and Lead-Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion-Resistant Sprinklers. Where Lead-Coated Sprinklers are noted to be FM Approved, the sprinklers are FM Approved as a Corrosion-Resistant Sprinklers.
- * Installed with Style 10 (1/2" NPT) or Style 40 (3/4" NPT) 3/4" Total Adjustment Recessed Escutcheon, as applicable. ** Installed with Style 20 (1/2" NPT) or Style 30 (3/4" NPT) 1/2" Total Adjustment Recessed Escutcheon, as applicable.
- *** Frame and Deflector only. Listings and approvals apply to color (Special Order).

N/A: Not Available

TABLE B LABORATORY LISTINGS AND APPROVALS FOR 5.6 AND 8.0 K-FACTOR SPRINKLERS

		SPRINKLER FINISH				
K FACTOR	ТҮРЕ	NATURAL BRASS	CHROME PLATED	SIGNAL WHITE	LEAD COATED	
2.8	PENDENT (TY1231) and UPRIGHT (TY1131)		N/A			
1/2" NPT	RECESSED PENDENT (TY1231)					
4.2	PENDENT (TY2231) and UPRIGHT (TY2131)		N/A			
1/2" NPT	RECESSED PENDENT (TY2231)		N/A			
5.6	PENDENT (TY3231) and UPRIGHT (TY3131)	OI	175 PSI (12,1 BAR)			
1/2" NPT	RECESSED PENDENT (TY3231)	Oi	N/A			
8.0	PENDENT (TY4231) and UPRIGHT (TY4131)	175 DCI (12.1 DAD)		175 PSI (12,1 BAR)		
3/4" NPT	RECESSED PENDENT (TY4231)	175 PSI (12,1 BAR)			N/A	
8.0 1/2" NPT	PENDENT (TY4931) and UPRIGHT (TY4831)	175 PSI (12,1 BAR)		175 PSI (12,1 BAR)		

NOTES:

TABLE C MAXIMUM WORKING PRESSURE

Care and Maintenance

The TYCO Series TY-FRB must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection systems from the proper authorities and notify all personnel who may be affected by this action.

Absence of the outer piece of an escutcheon, which is used to cover a clearance hole, can delay sprinkler operation in a fire situation.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified sprinklers must be replaced. Sprinklers that have been exposed to

corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.

Care must be exercised to avoid damage to the sprinklers - before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. (Ref. Installation Section.)

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association (e.g., NFPA 25), in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or sprinkler manufacturer regarding any questions.

Automatic sprinkler systems are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.


Care must be exercised to avoid damage to the sprinklers -before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. (Ref. Installation Section).


Initial and frequent visual inspections of random samples are recommended for corrosion-resistant sprinklers to verify the integrity of the corrosion-resistant material of construction. Thereafter, annual inspections per NFPA 25 should suffice.


Inspections of corrosion-resistant sprinklers are recommended at close range, instead of from the floor level per NFPA. Inspection at close range can better determine the exact sprinkler condition and the long-term integrity of the corrosion-resistant material, which can be affected by the corrosive conditions present.


The maximum working pressure of 250 psi (17,2 bar) only applies to the Listing by Underwriters Laboratories Inc. (UL); the Listing by Underwriters Laboratories, Inc. for use in Canada (C-UL); and, the Approval by the City of New York.


TFP171 Page 8 of 10

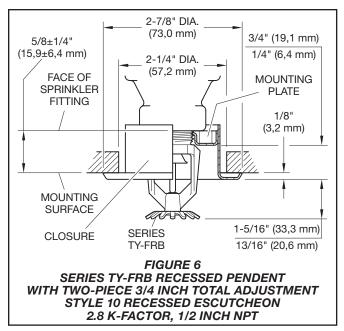


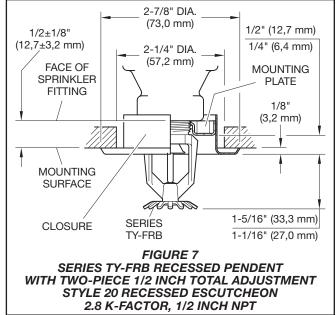


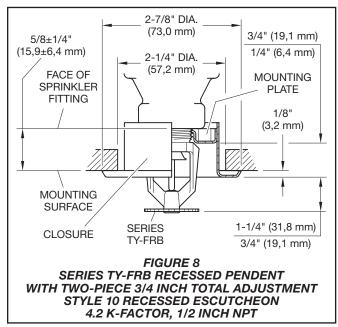


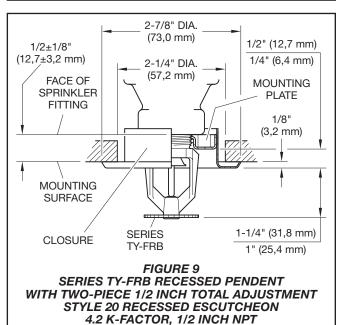


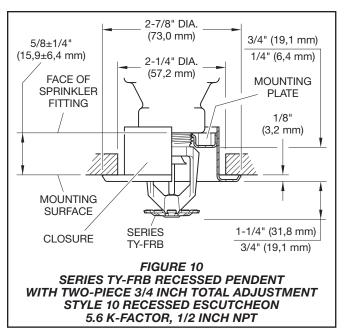


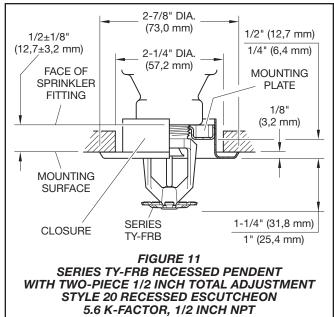

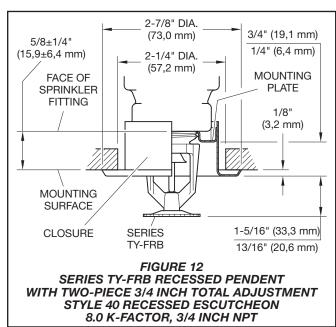

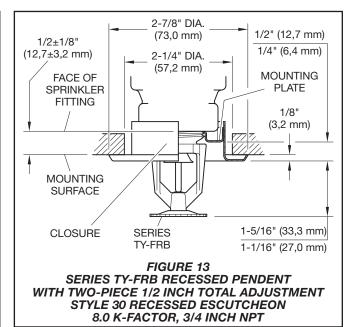





P/N 57	7 —	XXX	_	X	_	XXX

			SIN
33	30	2.8K UPRIGHT (1/2"NPT)	TY1131
33	31	2.8K PENDENT (1/2"NPT)	TY1231
34	10	4.2K UPRIGHT (1/2"NPT)	TY2131
34	41	4.2K PENDENT (1/2"NPT)	TY2231
37	70	5.6K UPRIGHT (1/2"NPT)	TY3131
37	371 5.6K PENDENT (1/2"NPT)		TY3231
39	390 8.0K UPRIGHT (3/4"NPT)		TY4131
39	391 8.0K PENDENT (3/4"NPT)		TY4231
36	360 8.0K UPRIGHT (1/2"NPT)		TY4831*
36	361 8.0K PENDENT (1/2"NPT)		TY4931*

		SPRINKLER FINISH			
1		NATURAL BRASS			
3		PURE WHITE (RAL9010)*			
4		SIGNAL WHITE (RAL9003)			
5		JET BLACK (RAL9005)**			
7		LEAD COATED			
9)	CHROME PLATED			
* [* Factora Hamianhara aslas an				

RATINGS 135 135°F (57°C) 155 155°F (68°C) 175 175°F (79°C) 200 200°F (93°C) 286 286°F (141°C)

TEMPERATURE

TABLE D SERIES TY-FRB PENDENT AND UPRIGHT SPRINKLERS PART NUMBER SELECTION

Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and Part Number (P/N).

Sprinkler Assemblies with NPT

Thread Connections

Specify: Series TY-FRB (Specify SIN), (specify K-factor), (specify Pendent or Upright) Sprinkler (specify) temperature rating, (specify) finish or coating, P/N (specify from Table D)

Recessed Escutcheon:

Specify: Style (10, 20, 30, or 40) Recessed Escutcheon with (specify*) finish, P/N (specify*)

Sprinkler Wrench

Specify: W-Type 6 Sprinkler Wrench, P/N 56-000-6-387

Specify: W-Type 7 Sprinkler Wrench, P/N 56-850-4-001

* Refer to Technical Data Sheet TFP770

GLOBAL HEADQUARTERS | 1400 Pennbrook Parkway, Lansdale, PA 19446 | Telephone +1-215-362-0700

^{*} Eastern Hemisphere sales only.

^{**} Available in only 2.8K, 4.2K, and 8.0K, 155°F (68°C) and 200°F (93°C); requires lead time to manufacture.